


WILLSCOT ENGINEERING ARCHITECTURE & INTERIOR DESIGN, INC. IS THE ARCHITECT OF RECORD FOR THIS PROJECT. THE ARCHITECT'S RESPONSIBILITIES ARE LIMITED TO THE DESIGN AND CONSTRUCTION OF THE BUILDING AS SHOWN ON THESE PLANS. THE ARCHITECT DOES NOT WARRANT THE ACCURACY OF ANY INFORMATION PROVIDED BY OTHERS. THE ARCHITECT'S LIABILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED. THE ARCHITECT'S LIABILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED. THE ARCHITECT'S LIABILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED.

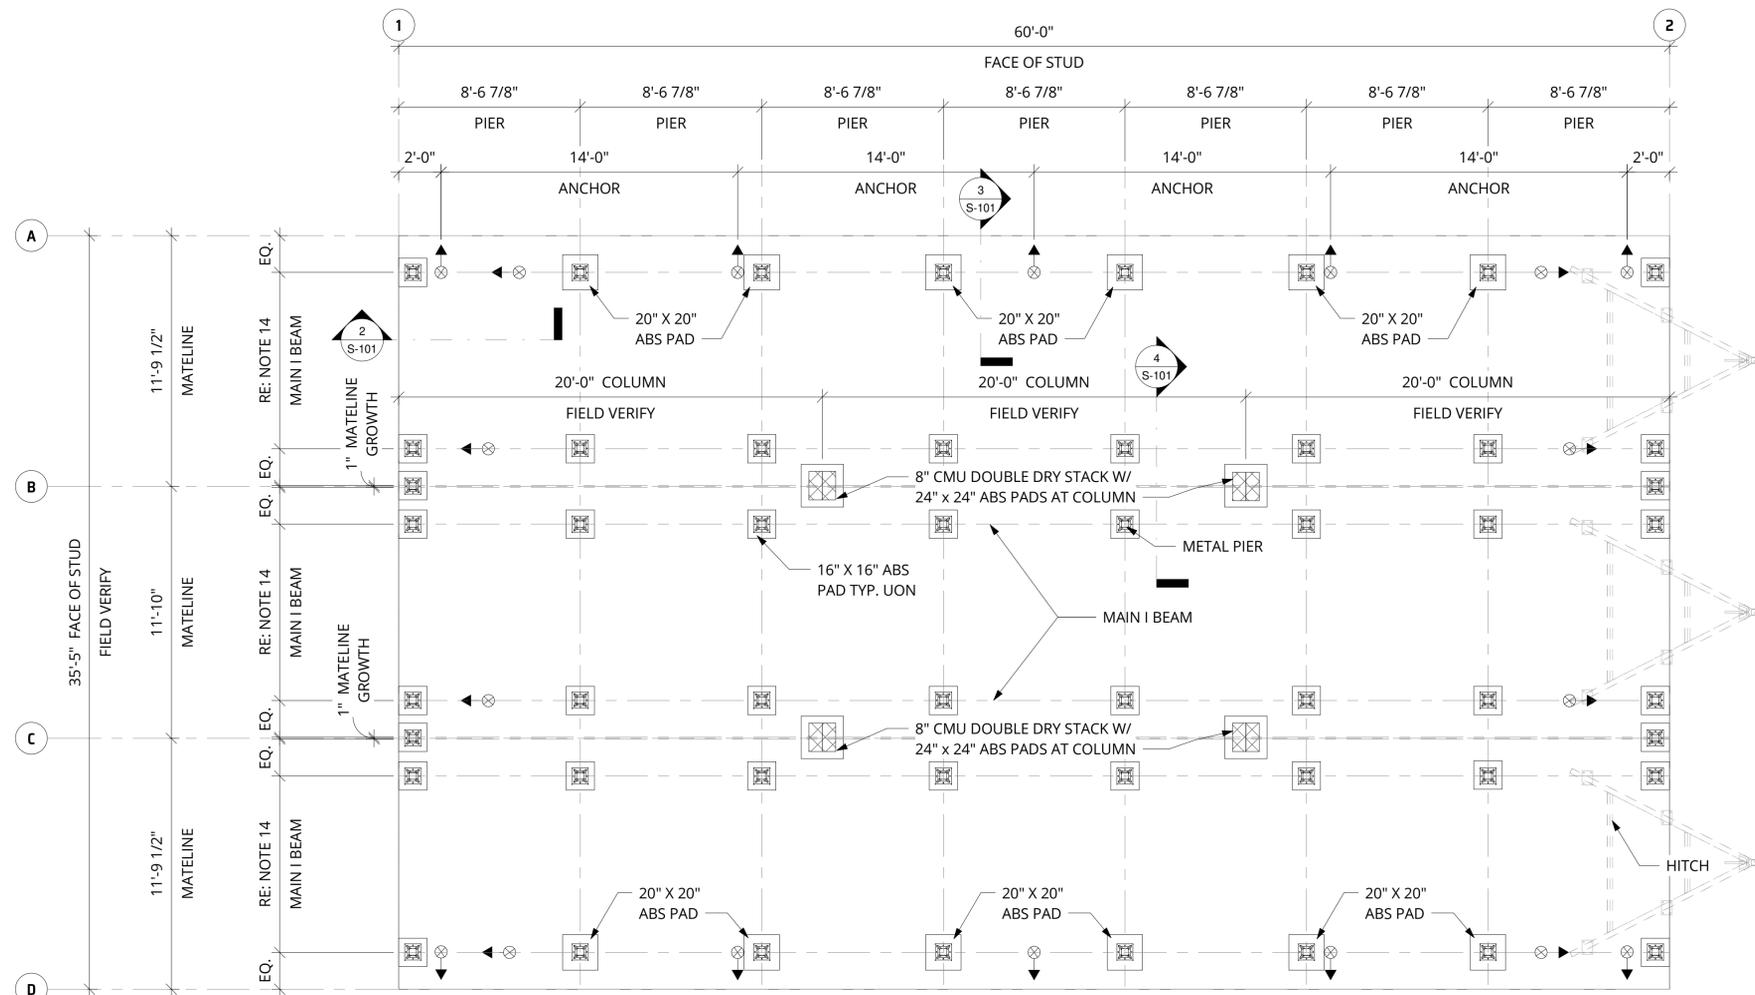

FOUNDATION NOTES:

- FOUNDATION REVIEW AND INSPECTION IS TO BE PERFORMED BY THE LOCAL OFFICIAL HAVING JURISDICTION.
- UNIT MAY BE SHIMMED AS REQUIRED BETWEEN TOP OF PIER AND MODULAR UNIT FRAME. HARDWOOD, METAL OR ABS SHIM CAN BE USED. WEDGE SHIM SHALL BE USED IN PAIRS.
- TIE-DOWN STRAPS TO BE 1-1/4" x .035" TYPE-1, FINISH B, GRADE I ZINC COATED STEEL STRAPPING AS CONFORMING WITH ASTM D3953-91. TIE DOWN STRAPS AND CONNECTING HARDWARE SHALL HAVE 3150# MINIMUM WORKING CAPACITY.
- UNDERGROUND UTILITY LOCATIONS ARE THE RESPONSIBILITY OF OTHERS. ALL UNDERGROUND UTILITY LOCATIONS MUST BE VERIFIED PRIOR TO ANY EXCAVATION.
- PROVIDE 1 SQUARE FOOT OF CRAWL SPACE VENTILATION FOR EACH 150 SQUARE FEET OF CRAWL SPACE AREA. IF SUITABLE VAPOR BARRIER IS PROVIDED RATIO CAN BE INCREASE TO 1/1500.
- PROVIDE MINIMUM CRAWL SPACE UNDER ACCESS UNIT OF 18" x 24".
- DIMENSIONS SHALL BE FIELD VERIFIED.
- FINISHED FLOOR ELEVATION FFE = 100'-0" IS FOR REFERENCE ONLY
- ALLOWABLE SOIL BEARING CAPACITY IS 2500 PSF.
- FIELD VERIFY EXISTING CONDITION. IF THERE ARE DISCREPANCIES, THE ENGINEER OF RECORD SHALL BE NOTIFIED.
- MINUTE MAN PRODUCT SHALL BE INSTALLED PER MANUFACTURER SPECIFICATION.
- ALL PIERS SHALL BE RATED FOR 6000 LBS.
- DOUBLE DRY STACK CMU SHALL NOT EXCEED 48 INCHES IN HEIGHT WITHOUT PERIMETER CEMENT BONDING.
- DIMENSION BETWEEN MAIN I BEAM SHALL BE FIELD VERIFIED BEFORE THE SETUP OF MODULAR UNITS.

BUILDING LEGEND:

⊗ → INDICATES MINUTE MAN ANCHOR OR APPROVED EQUAL AUGER ANCHOR WITH STABILIZER PLATE. TOP OF ARROW INDICATES ANCHOR LOCATION.

DESIGN LOAD:

BUILDING CODE: 2022 OR STRUCTURAL SPECIALTY CODE
 ROOF LIVE LOAD = 20 PSF
 FLOOR LIVE LOAD = 50 PSF
 FLOOR DEAD LOAD = 10 PSF
 ROOF DEAD LOAD = 10 PSF
 EXTERIOR WALL DEAD LOAD = 60 PLF

WIND SPEED

V = 98 MPH (ULT)
 V = 76 MPH (ASD)
 EXPOSURE C
 INTERNAL PRESSURE COEFFICIENT GCpi = ± 0.18
 RISK CATEGORY II

SNOW LOAD + RAIN-ON-SNOW SURCHARGE:
 ROOF SNOW LOAD Pf = 25 PSF

SEISMIC LOADS:


RISK CATEGORY - II
 MAPPED SPECTRAL RESPONSE ACCELERATIONS - Ss = 0.754, S1 = 0.33
 SITE CLASS - D
 SPECTRAL RESPONSE COEFFICIENT - Sds = 0.603, Sd1 = 0.433
 SEISMIC DESIGN CATEGORY D
 BASIC FORCE RESISTING SYSTEM - LIGHT FRAMED WOOD WALL SHEATHED WITH WOOD STRUCTURAL PANEL RATED FOR SHEAR RESISTANCE
 ANALYSIS PROCEDURE - EQUIVALENT LATERAL FORCE PROCEDURE
 RESPONSE MODIFICATION FACTOR - R = 6.5
 SEISMIC RESPONSE COEFFICIENT - Cs = 0.0928
 DESIGN BASE SHEAR - V = 5.0 K

ABS PAD NOTES:


- CLEAR ALL VEGETATION AND DEBRIS FROM THE AREA WHERE THE ABS PAD ARE TO BE PLACED.
- GROUND UNDER ABS PAD SHALL BE LEVELED AND EVENLY COMPACTED.
- PLACE ABS PAD WITH GRID SIDE UP, SMOOTH SIDE DOWN.

MATERIAL QUANTITY	
DESCRIPTION	COUNT
16" X 16" ABS PAD	40
20" X 20" ABS PAD	12
24" X 24" ABS PAD	4
MINUTE MAN ANCHOR OR APPROVED EQUAL AUGER ANCHOR WITH STABILIZER PLATE	18
MINUTE MAN ANCHOR OR APPROVED EQUAL MMA-34 & MMA-71C	8
WRAP METAL STRAP AROUND STEEL BEAM WITH MINUTE MAN APPROVED OR EQUAL MMA-32 BUCKLE STRAP	10


1 FOUNDATION PLAN
 1/4" = 1'-0"

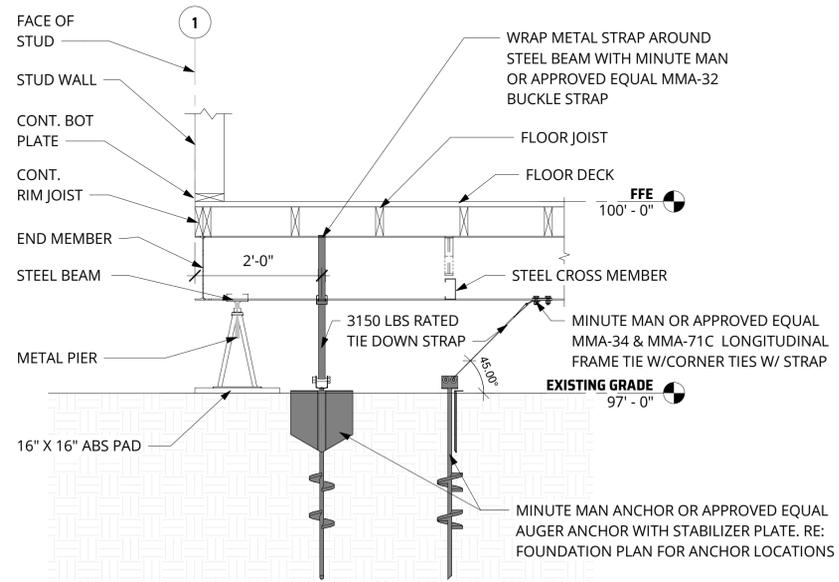

2 END WALL SECTION
 3/4" = 1'-0"

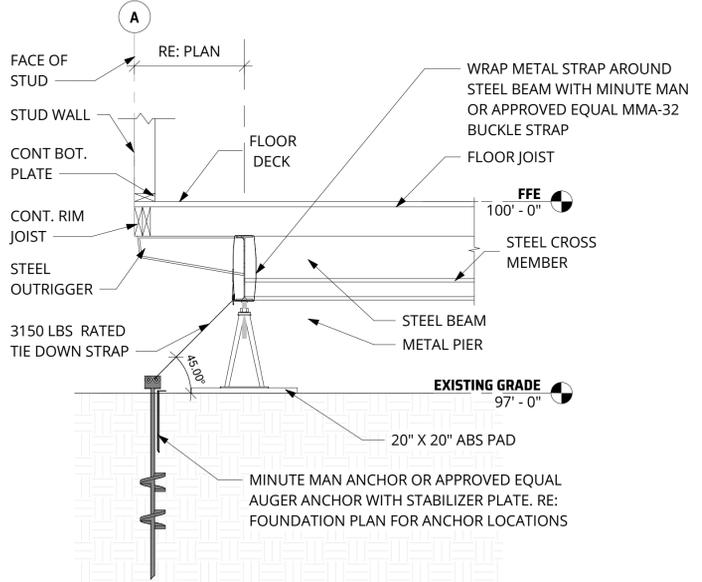

3 OUTRIGGER SECTION
 3/4" = 1'-0"

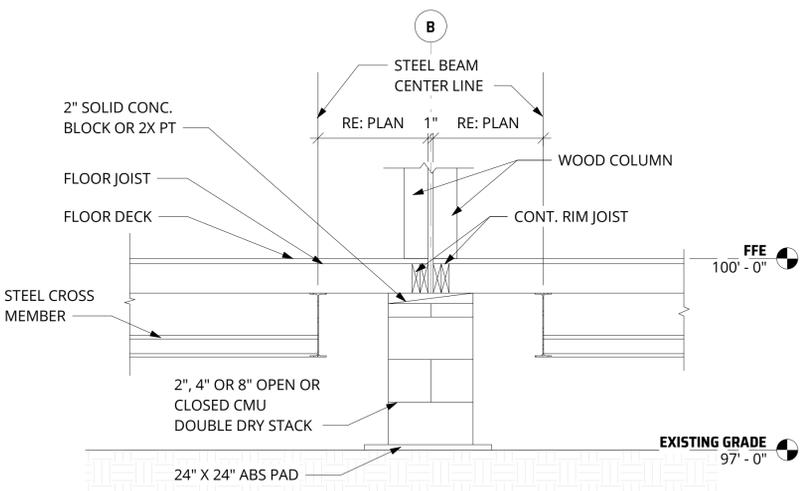

4 COLUMN MATELINE SECTION
 3/4" = 1'-0"

WILLSCOT
 WILLIAMS SCOTSMAN INC.
 4646 East Van Buren Street,
 Suite 400, Phoenix, AZ 85008
 800.782.1500 | WILLSCOT.COM



10/3/2024
 REGISTERED PROFESSIONAL ENGINEER
 87081PE
 OREGON REGISTERED PROFESSIONAL ENGINEER
 THYRIE R. LEBOULCH
 EXPIRES: 12/31/2024

Digitally signed by Thierry Leboulch
 Date: 2024.10.07 08:35:14 -05'00'

BULL RUN FILTRATION
(3) 12 X 60 MODULAR UNITS
 36800 SE LUSTED RD
 BORING, OR 97009

ISSUE	DATE	DESCRIPTION
FILE #:	WS2024-1427	
DRAWN BY:	AD	
DATE:	10/2/2024	
REP:	RICK RAYHEL	
ASSET #:		
ASSET TYPE:	E-PLEX	
MODEL:	CPX-11650	

FOUNDATION PLAN AND SECTIONS

S-101